


LAMPIRAN

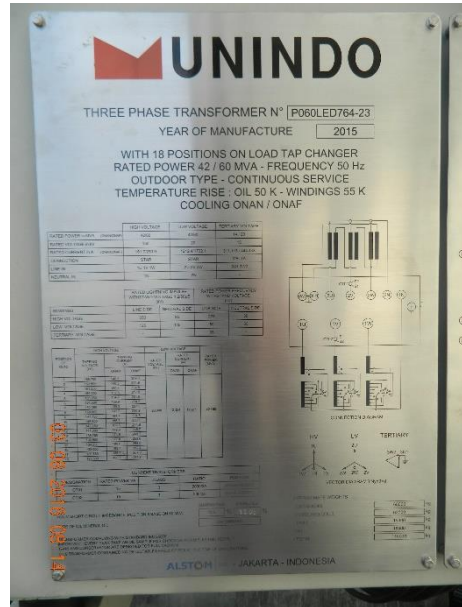

**PT PLN (PERSERO)**  
**TRANS-SIT - APP SURABAYA**

**DATA SETTING RELAY GI KENTINGAN**  
**TAJAO III (MUNINDO) YNN(DT) 40 MVA 150/20 KV XT 12.0% %**

JENIS RELAY	TYPE RELAY	Setting Relay Baru
OCER dan CTR 440/150 kV	AREVA MICOM P141	Auto CT = 24000 In R <sub>y</sub> = 1
OCER dan CTR 440/150 kV	AREVA MICOM P141	Function I> : Yes
		Function I< : No
		Delay Type : S(10CD)
		Time : 0.34 s
		Function I>> : Yes
		Delay Type : DMT
		Time : 0.00 s
		Function I<> : No
		Delay Type : DMT
		Time : 0.00 s
		Function I<< : No
		Delay Type : DMT
		Time : 0.00 s
OCER dan CTR 440/20 kV	SCREEDER MICOM P141	Auto CT = 24000 In R <sub>y</sub> = 1
		Function I> : Yes
		Function I< : No
		Delay Type : DMT
		Time : 0.16 s
		Function I>> : Yes
		Delay Type : DMT
		Time : 0.16 s
		Function I<> : Yes
		Delay Type : DMT
		Time : 3.46 In
		Function I<< : No
		Delay Type : DMT
		Time : 0.700 s
		Function I>>> : Yes
		Delay Type : DMT
		Time : 5.51 In
		Function I<>> : No
		Delay Type : DMT
		Time : 0.000 s
		Function I<<> : No
		Delay Type : DMT
		Time : 0.146 In
		Function I<<< : No
		Delay Type : DMT
		Time : 0.10 s
		Function I>>> : No
		Delay Type : DMT
		Time : 2.61 In

**PROJEKSI APP SURABAYA**  
Tgl. Pengiriman : 15/02/2018  
Dibuat oleh : MISAJI  
Dibuat oleh : APP/MTN  
Dibuat oleh : 29/02/2018